
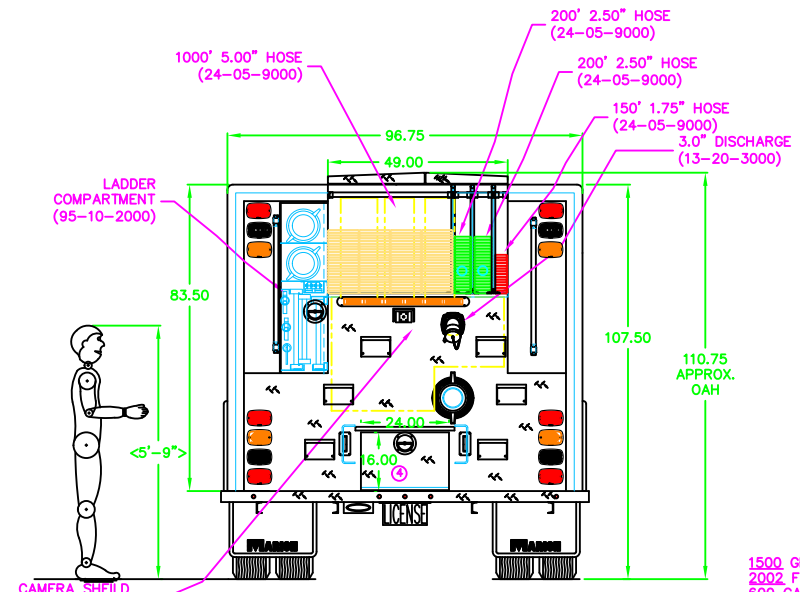


PRINT APPROVAL
 I HAVE EXAMINED THIS DOCUMENT AND APPROVE IT WITH NOTED REVISIONS, IF ANY, IN RED.
 SIGNATURE _____
 DATE _____

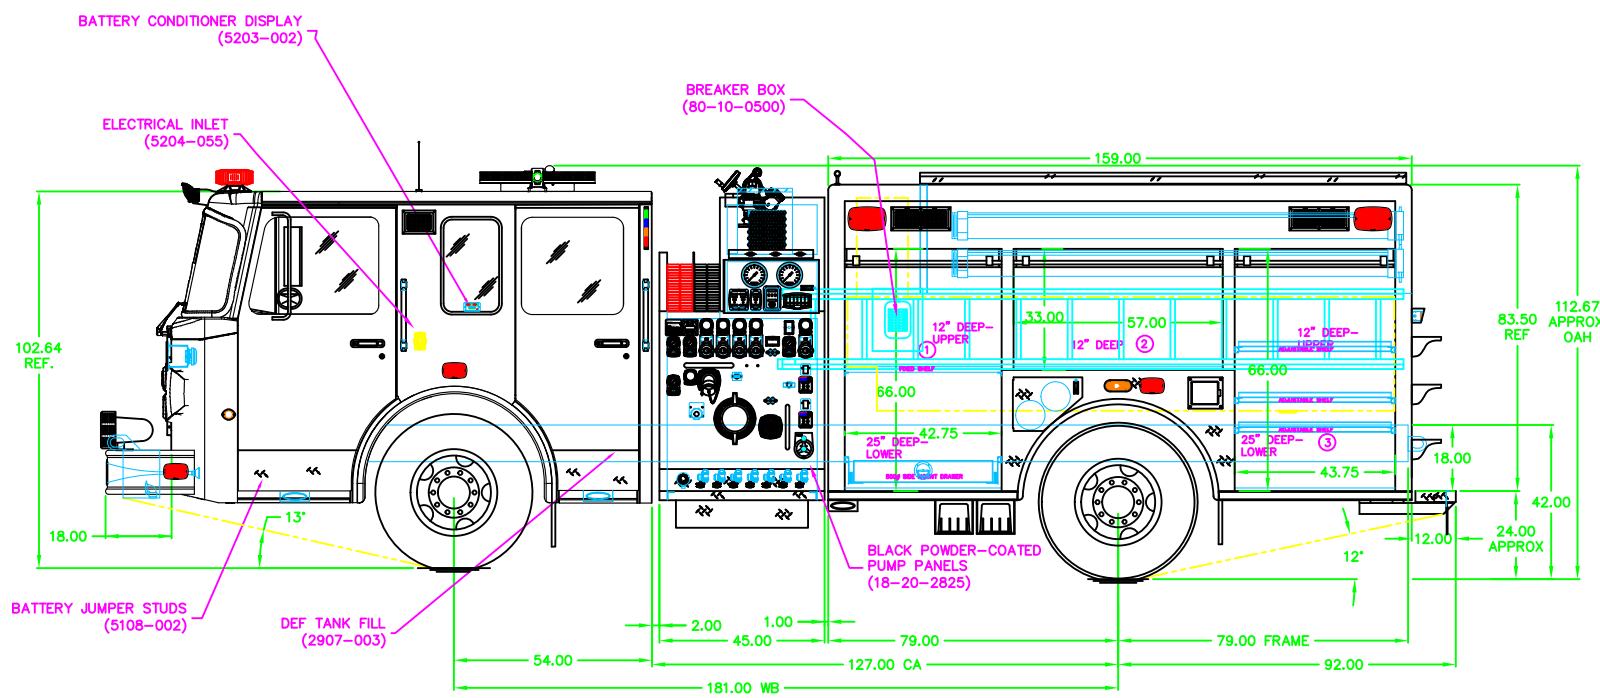

1500 GPM HALE QMAX PUMP
 2002 FOAMPRO FOAM SYSTEM
 600 GAL POLYPROPYLENE TANK
 20 GAL INTEGRAL FOAM TANK CLASS A
 20 GAL INTEGRAL FOAM TANK CLASS B
 81589 MBW NUMBER

MAXIMUM OVERALL LENGTH SPECIFIED (33-49-1000) 30' 8" or 368"
 MAXIMUM OVERALL HEIGHT SPECIFIED (33-49-2000) 9' 5" or 113"

G	6/28/18	JK	REVISED PER FLAT BACK OVERLAY
F	5/30/18	JK	REVISED PER BUILD MEETING
E	5/22/18	JK	REVISED PER SALES MARKUP
D	1/24/18	JK	REVISED PER SALES CHANGES (CURBSIDE UPPER COMPARTMENTS)
C	1/17/18	JK	REVISED PER-CON MEETING
B	12/21/17	JK	REVISED PER SUBMITTAL MEETING
A	12/15/17	JK	REVISED PER SALES MARKUP & SPECS
LTR	DATE	BY	DESCRIPTION

MARION MARION BODY WORKS, INC.
 P.O. BOX 5500
 MARION WISCONSIN 54950-0500
 715/254-5251 FAX 715/254-5774

CHASSIS SPECS
 SPARTAN
 MODEL FOR OSWEGATCHIE FIRE CO. WATERFORD, CT
 DRAWN BY JK APPROVED BY JK DATE 7/19/17 SCALE 1/20
 DRG. NO. 98047260 SHEET 1 OF 1